

SYMBOL NOTES:

- 1 8" THK. 4,000 PSI CONC SLAB @ LOADING DOCK DRIVE - REINF. W/ 6x6:6x6 W.W.M. - SEE ENLARGED PLAN SHEET A-3.0
- 2 6" THK. 3,500 PSI CONC. SLAB @ DOCK - REINF. W/ 6x6:6x6 W.W.M. ON COMP. FILL.
- 3 6" THK. 3,500 PSI CONC. @ WAREHOUSE AREA - REINF. W/ 6x6:6x6 W.W.M. & 6 MIL. POLY V.B. OVER 4" STONE BASE.
- 4 4" THK. 3,500 PSI CONC. @ RETAIL AREA - REINF. W/ 6x6:10x10 W.W.M. OVER 6 MIL POLY V.B. OVER 4" STONE BASE - SEE FINISH SCHEDULE FOR REQUIRED FINISHES - TYP. ALL AREAS.
- 5 QUIK-BRIK - SEE SECTIONS, DETAILS, & ELEVATIONS FOR TYPE & COLORS REQUIRED - TYP. ALL AREAS. FOAM ALL BUILDING WALLS AS PER SPECIFICATIONS - SEE STRUCTURAL FOR SEISMIC REINFORCING & FILL.
- 6 STRUCTURAL COLUMNS - SEE STRUCTURAL DRAWINGS.
- 7 4" THK. 3,000 PSI CONCRETE WALKS @ BUILDING - SEE SHEET A-1.1 AND ALSO COORDINATE WITH SITE / CIVIL DRAWINGS FOR ADDITIONAL DETAIL.
- 8 CONT. 2x6s @ BASE & CHAIR RAIL LOCATED @ 42" A.F.F. (TOP) - SEE FINISH SCHEDULE - INSTALL TREATED 2xs AT BASE & INSTALL PAINT GRADE POPLAR 2xs @ CHAIR RAIL.
- 9 3.5/8" 20 GA. METAL STUDS @ 24" O.C. SPACING W/ C1" x 1" PURLINS & 3.1/2" F-G BATT INSULATION - COVER W/ 5/8" GYP. BD. (TYPE "X" @ TOILETS & JANITOR) - PAINTED - WALLS TO 10'-0" A.F.F. - SEE DETAIL 8 / A-2.0
- 10 8" BLOCK WALL - 3 HR. RATED - SEAL TO DECK, SEE DETAIL SHEET A-2.0 - BLOCK TYPE CLASSIFICATION C-3
- 11 3.5/8" 20 GA. METAL STUDS @ 24" O.C. SPACING W/ 1" x 1" PURLINS & 3.1/2" F-G BATT INSUL. - COVER W/ 5/8" GYP. BD. PAINTED - SEE DETAIL 6 / A-2.0
- 12 BOX-IN STRUCTURAL COLUMNS W/ 3.5/8" METAL STUDS & 5/8" GYP. BD. - SEE DETAIL 2 / A-2.0
- 13 2'-2" w x 3'-6" h 1/4" THK. TEMP GLASS IN WOOD CASE FRAME - ALIGN W/ DOOR HEADS.
- 14 DRESSING ROOM WALLS TO EXTEND UP TO 9'-0" A.F.F. - CAP W/ 1x PAINTED BOARD AND 2" CASING SKIRT - SEE DETAIL 4 / A-2.0
- 15 INSTALL 3/4" PLYWOOD OR "OSB" WINDOW SILL - COVERED ON ALL SIDES WITH PLASTIC LAMINATE & CAULK TO WINDOW FRAME - COLORS AS SELECTED.
- 16 OVERHEAD CAN DOOR W/ VINYL STRIP DOOR CURTAIN - SEE DOOR SCHEDULE & DOOR TYPES SHEET A-4.0.
- 17 INSTALL FIRE SHUTTER THIS LOCATION - SEE DOOR SCHEDULE.
- 18 RETAINING WALL - SEE STRUCTURAL.
- 19 3.5/8" 20 GA. METAL STUDS @ 24" O.C. SPACING W/ C1" x 1" PURLINS & 3.1/2" F-G BATT INSUL. - RUN STUDS TO DECK & COVER W/ 5/8" GYP. BD. TO 10'-0" A.F.F. ONLY.
- 20 FRAME CEILINGS @ 9'-0" A.F.F. WITH 8" 18 GA. 800 CSJ @ 24" O.C. - ALIGN OVER STUDS & APPLY 5/8" GYP. BD. CLG. (PAINTED) & INSULATE W/ 6" F-G BATTS - TYPICAL. SEE SHEET A-2.0


GENERAL NOTES:

- / SEE DOOR SCHEDULE, WINDOW SCHEDULE, DOOR TYPES, SEE SHEET A-4.0
- / SEE STRUCTURAL SHEET S-1.0 FOR FOUNDATION PLAN AND CONSTRUCTION JOINT LOCATIONS AT FLOORS.


FLOOR PLAN

SCALE 3/32" = 1'-0"


- 21 INSTALL 3/4" HAT CHANNELS ONTO BLOCK WALL & COVER WALL W/ 5/4" THK. FIRE RETARDANT PLYWOOD FOR PHONE BD. (PAINTED) - (ENTIRE WALL) SEE SCHEDULE.
- 22 FURR OUT WALL W/ 7/8" CHANNELS & INSTALL 5/8" GYP. BD. PAINTED.
- 23 SEE TYPICAL FRAMING @ STUDWALLS FOR DOORS SHEET A-4.0
- 24 6" 20 GA. METAL STUDS @ 24" O.C. SPACING W/ C1" x 1" PURLINS & 3.1/2" F-G BATT INSUL. - COVER W/ 5/8" GYP. BD. (PAINTED) SEE DETAIL SHEET A-2.0 - PLUMBING CHASE LOCATIONS AS PER PLAN.
- 25 EXTEND 4" CONC. WALK UP TO DOOR #019 @ JOB LINK COVERED ENTRY AS PER A-1.1
- 26 INSTALL AL. STOREFRONT DOOR & FRAME THIS LOCATION - SEE SCHEDULE
- 27 BOX-IN STRUCTURAL COL W. 3.5/8" METAL STUDS & 5/8" GYP. BD. - EXTEND UP TO DECK ON RETAIL SIDE & ABOVE CLG. @ OFFICE. - CAULK, PRIME & PAINT - SEE DET. 1 THIS SHEET.
- 28 APPROXIMATE BAILER LOCATION - VERIFY W/ OWNER PRIOR TO ELECTRICAL INSTALLATION SEE ELEC.
- 29 INSTALL 42" w x 36" h, HINGED ACCESS PANEL @ 10'-0" A.F.F. 3/4" PLYWOOD W/ LATCH & WOOD CASING - PAINT OUT TO MATCH WALL - ADJ. HOT. TO AVOID BOTTOM CHORD OF BAR JOIST.
- 30 INSTALL 3/4" OSB DECKING OVER 800 CSJ JOISTS ABOVE LUNCH ROOM AS INDICATED (HATCHED) FOR MECH. PLATFORM
- 31 G.C. TO INSTALL ADDITIONAL LAYER OF 5/8" GYP. BD. THIS WALL BETWEEN LUNCH ROOM & TOILET AREAS. FULL HOT.
- 32 FURR OUT BLOCK WALL W/ 7/8" FURRING CHANNELS & INSTALL 5/8" GYP. BD. TO RECEIVE RECEIVE FRP PANELS - SEE FINISH SCHEDULE - SEE ALSO ENLARGED TOILET PLAN SHEET A-4.1
- 33 8' x 10' x 4" THK. 3,000 PSI CONC. SLAB @ REAR EXIT - SLOPE 1/4" / 12" FROM BUILDING.
- 34 BOX-IN COL. W/ 3.5/8" METAL STUDS & 5/8" GYP. BD. EXTEND TO ABOVE CEILING.

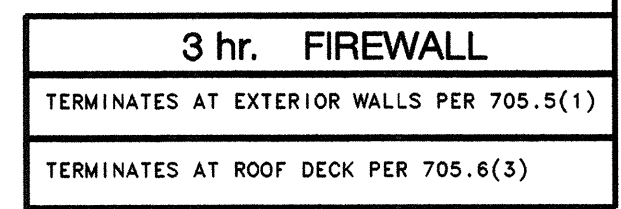

SEE WALK PLAN SHEET A-1.1
 SEE SITE DRAWINGS FOR CONTINUATION OF ALL CURBS, WALKS, DRIVES, ETC.

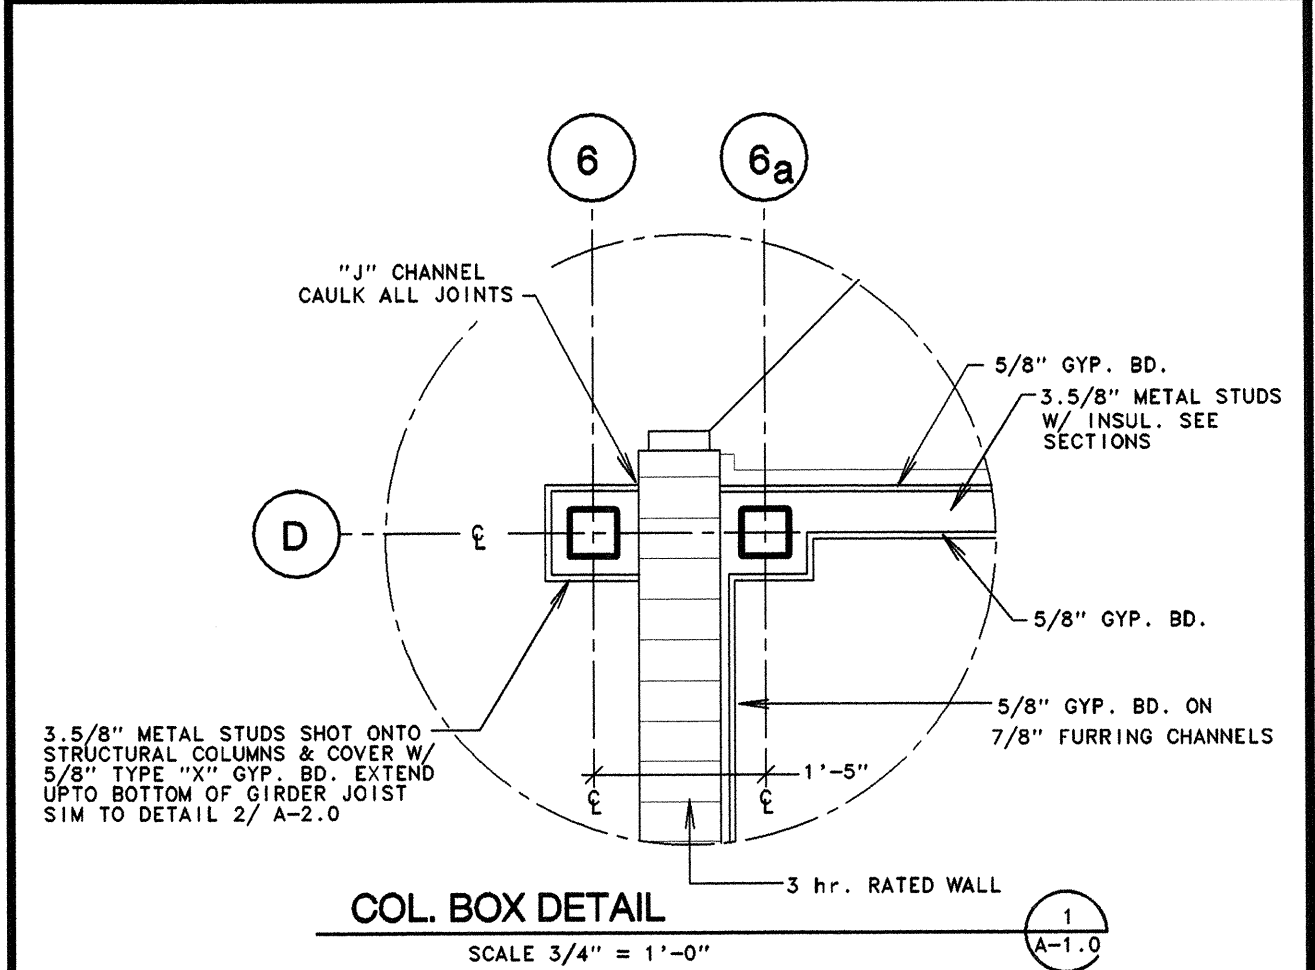

FINISH SCHEDULE

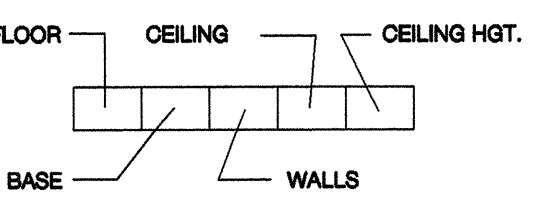

- FLOOR:**
- 01 CONCRETE - POLISHED, SEE SPECIFICATIONS.
 - 02 12" x 12" x 1/8" VCT - SEE SPECIFICATIONS
 - 03 CARPET TILES AS SELECTED - SEE SPECIFICATIONS
 - 04 CONCRETE - SEALED
- BASE:**
- 10 4" RUBBER COVE
 - 11 2x6 BASE + 2x6 CHAIR RAIL BUMPER STRIPS @ 42" A.F.F. - CONT. PAINTED - INSTALL TREATED 2xs @ BASE - PAINT GRADE POPLAR @ 42" A.F.F.
 - 12 NONE

GENERAL NOTES:

- 1. EXTEND GYP. BD. ON INTERIOR WALLS FULL HOT - SEE SCHEDULE BELOW
- 2. PURLINS TO BE INSTALLED IN ALL STUD WALLS @ MIDPOINT, SEE SECTIONS.
- 3. COORDINATE ALL FINISHES LISTED WITH SPECIFICATIONS & ARCHITECT.

WALLS:

- 20 INTERIOR MASONRY WALLS, PAINTED PER SPECIFICATIONS.
- 21 5/8" GYP. BD. PRIME + TWO COATS LATEX SEMI-GLOSS AS PER SPECIFICATIONS.
- 22 FRP PANELS ON FRAME WALLS TO CEILING OVER 5/8" MOISTURE RESISTANT GYP. B.D. / FRP PANELS ON 5/8" GYP. BD. OVER 7/8" FURRING CHANNELS AT BLOCK WALLS

CEILING:

- 30 EXPOSED OPEN CEILINGS - PAINTED (DRY FOG WHITE)
 - 31 5/8" GYP. BD. - PAINTED FINISH.
 - 32 LAY-IN - 2x4 GRID W/TILES AS SELECTED.
- CEILING HGHT.:**
- 40 15'-4" @ EXPOSED OPEN CEILING TO DECK SLOPES TO 12'-8" @ REAR WALL.
 - 41 9'-0" @ GYP. BD. CEILINGS.
 - 42 10'-0" +/- A.F.F.