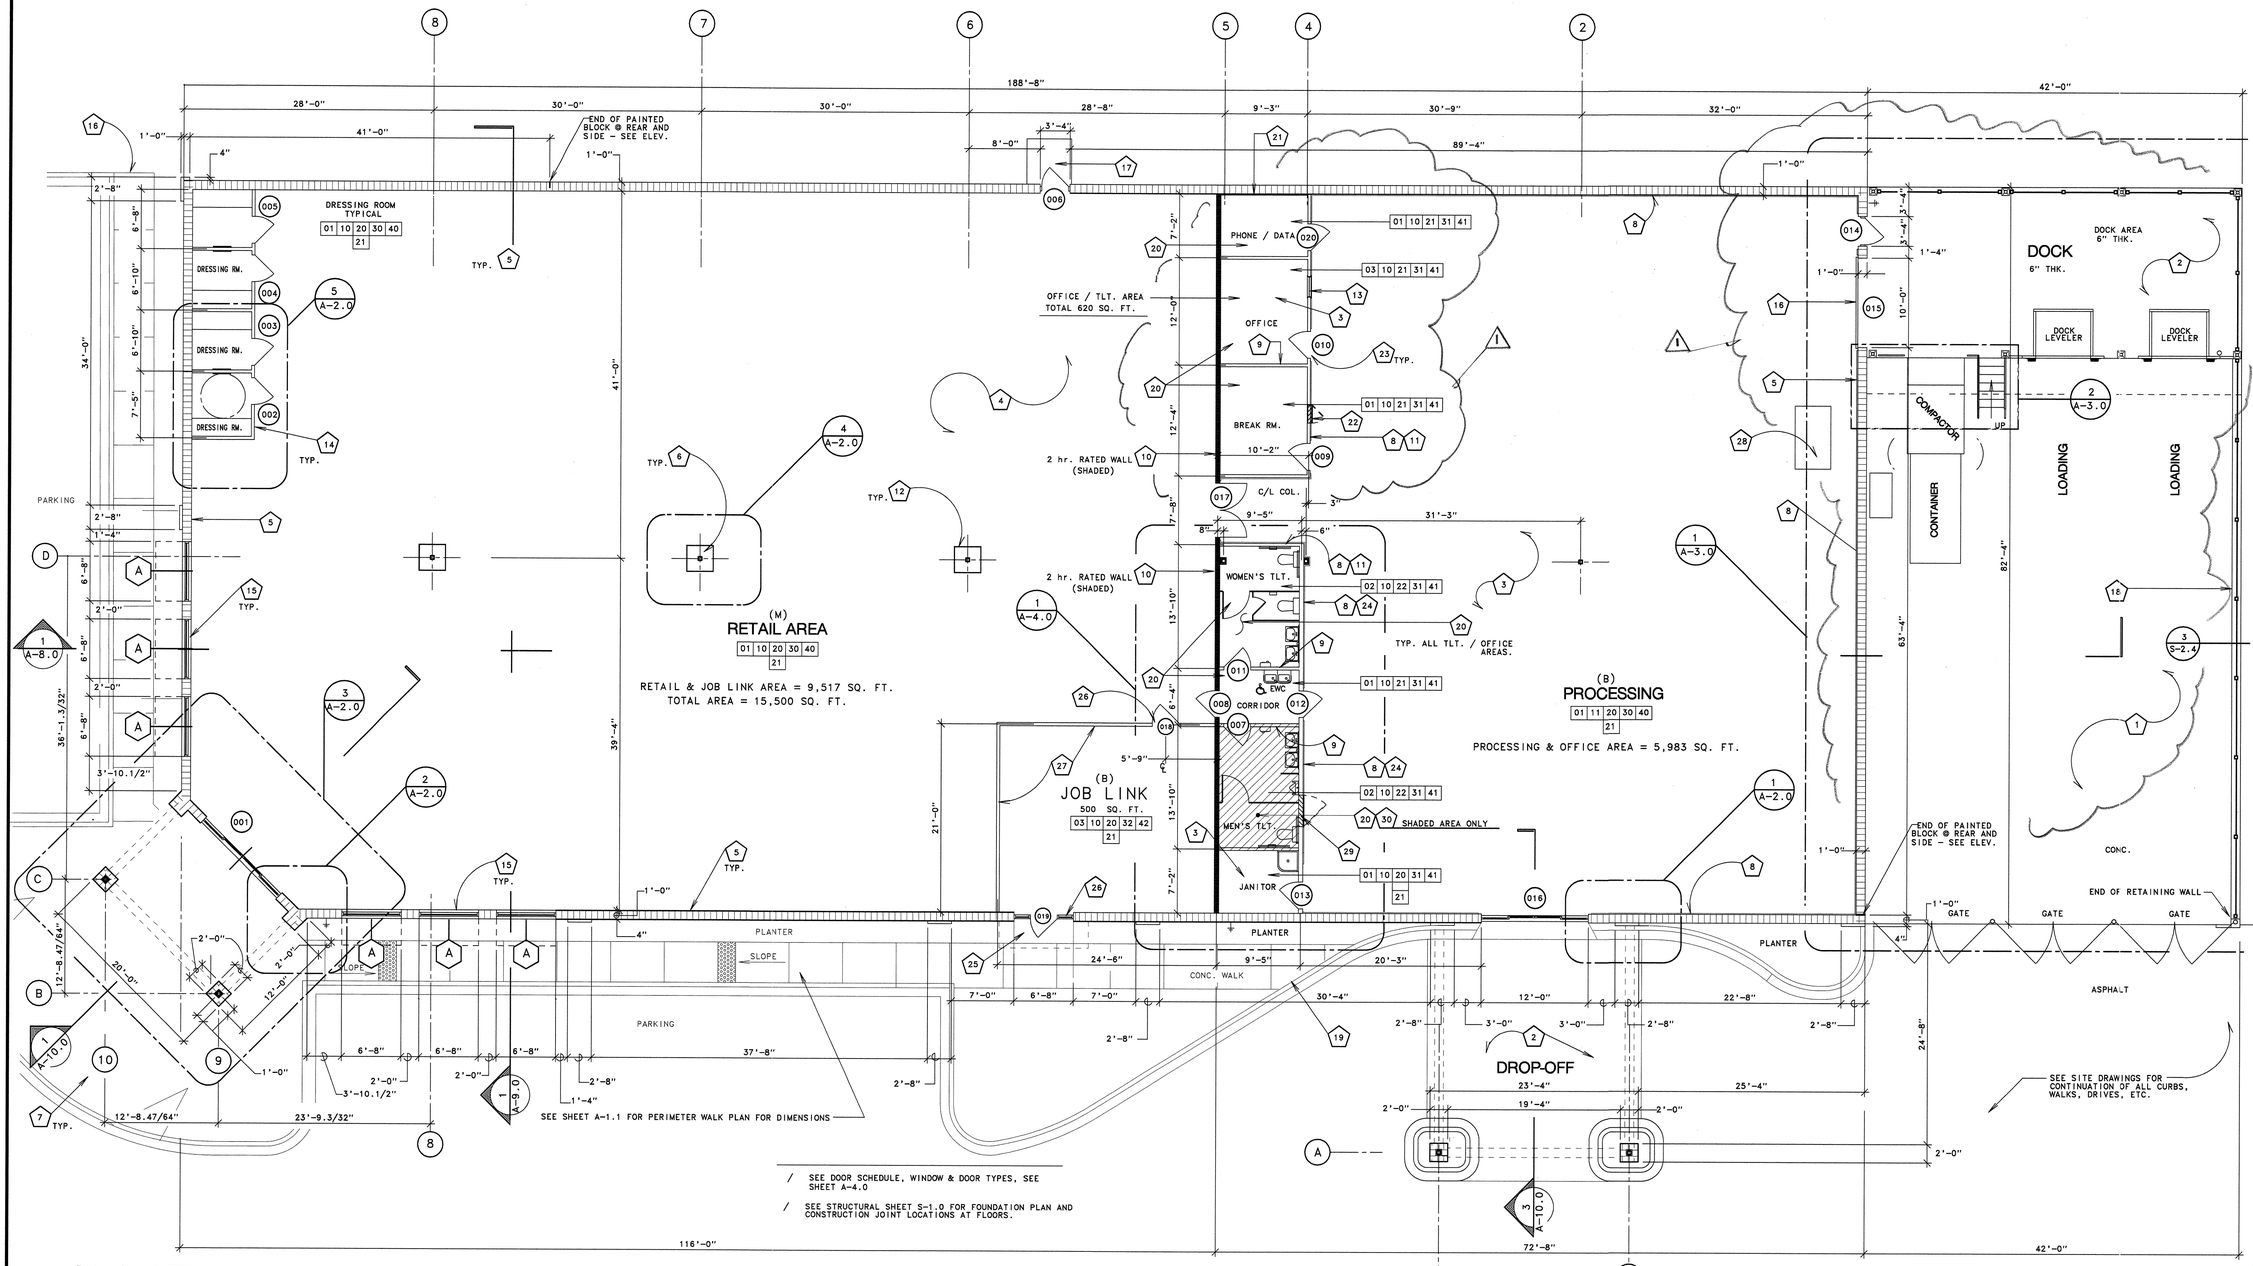

/ SEE DOOR SCHEDULE, WINDOW & DOOR TYPES, SEE SHEET A-4.0

/ SEE STRUCTURAL SHEET S-1.0 FOR FOUNDATION PLAN AND CONSTRUCTION JOINT LOCATIONS AT FLOORS.

FLOOR PLAN

SCALE 1/8" = 1'-0"

SYMBOL NOTES:

1. 8" THK. 4,000 PSI CONC SLAB @ LOADING DOCK DRIVE - REINF. W/ 6x6:6x6 W.W.M. - SEE ENLARGED PLAN SHEET A-3.0
2. 6" THK. 3,500 PSI CONC. SLAB @ DOCK - REINF. W/ 6x6:6x6 W.W.M. ON COMP. FILL.
3. 6" THK. 3,500 PSI CONC. @ WAREHOUSE AREA - REINF. W/ 6x6:6x6 W.W.M. & 6 MIL. POLY V.B. OVER 4" STONE BASE.
4. 4" THK. 3,500 PSI CONC. @ RETAIL AREA - REINF. W/ 6x6:10x10 W.W.M. OVER 6 MIL POLY V.B. OVER 4" STONE BASE - SEE FINISH SCHEDULE FOR REQUIRED FINISHES - TYP. ALL AREAS.
5. SPLIT/SMOOTH FACE CMU - SEE SECTIONS, DETAILS, & ELEVATIONS FOR TYPE & COLORS REQUIRED - TYP. ALL AREAS. FOAM ALL BUILDING WALLS AS PER SPECIFICATIONS - SEE STRUCTURAL FOR SEISMIC REINFORCING & FILL.
6. STRUCTURAL COLUMNS - SEE STRUCTURAL DRAWINGS.
7. 4" THK. 3,000 PSI CONCRETE WALKS @ BUILDING - COORDINATE W/ SITE / CIVIL DRAWINGS FOR ADDITIONAL DETAIL.
8. CONT. 2x6s @ BASE & CHAIR RAIL LOCATED @ 42" A.F.F. (TOP) - SEE FINISH SCHEDULE - INSTALL TREATED 2xs ONTO BLOCK WALLS.
9. 3.5/8" 20 GA. METAL STUDS @ 24" O.C. SPACING W/ C1" x 1" PURLINS & 3.1/2" F-G BATT INSULATION - COVER W/ 5/8" GYP. BD. (TYPE "X" @ TOILETS & JANITOR) - PAINTED - WALLS TO 10'-0" A.F.F. - SEE DETAIL 8 / A-2.0
10. 6" - 20 GA. METAL STUDS @ 24" O.C. SPACING W/ [1" x 1" PURLINS + 3.1/2" F-G BATT INSUL. - COVER W/ 2 LAYERS OF TYPE "X" 5/8" GYP. BD. PAINTED - WALLS SEALS TO DECK - 2 hr. RATED WALL - SEE DETAIL 7 / A-2.0
11. 3.5/8" - 20 GA. METAL STUDS @ 24" O.C. SPACING W/ [1" x 1" PURLINS + 3.1/2" F-G BATT INSUL - COVER W/ 5/8" GYP. BD. PAINTED - SEE DETAIL 6 / A-2.0
12. BOX-IN STRUCTURAL COLUMNS W/ 3.5/8" METAL STUDS & 5/8" GYP. BD. - SEE DETAIL 4 / A-2.0
13. 2'-2"w x 3'-6"h 1/4" THK. TEMP GLASS IN WOOD CASE FRAME - ALIGN W/ DOOR HEADS.
14. DRESSING ROOM WALLS TO EXTEND UPTO 9'-0"+/- A.F.F. - CAP W/ 1x PAINTED BOARD AND 2" CASING SKIRT.
15. INSTALL 3/4" PLYWOOD OR "OSB" WINDOW SILL - COVERED ON ALL SIDES WITH PLASTIC LAMINATE & CAULK TO WINDOW FRAME - COLORS AS SELECTED.
16. OVERHEAD CAN DOOR W/ VINYL STRIP DOOR CURTAIN - SEE DOOR SCHEDULE & DOOR TYPES SHEET A-4.0.
17. 5' x 5' x 4" THK. 3,500 CONC. PAD @ REAR ENTRY - REINF W/ 6x6:10x10 W.W.M.
18. RETAINING WALL
19. END OF CONCRETE WALK - SEE SITE PLANS & A-1.1
20. FRAME CEILINGS @ 9'-0" A.F.F. WITH 8" 18 GA. 800 CSJ @ 24" O.C. ALIGN OVER STUDS & APPLY 5/8" GYP. BD. CLG. (PAINTED) & INSULATE W/ 6" F-G BATTS - TYPICAL.
21. INSTALL 3/4" HAT CHANNELS ONTO BLOCK WALL & COVER WALL W/ 3/4" THK. FIRE RETARDANT PLYWOOD FOR PHONE BD. (PAINTED) - (ENTIRE WALL) SEE SCHEDULE.
22. PROVIDE 24" w. x 24" h. HINGED ACCESS PANEL @ 10'-0" A.F.F. 3/4" PLYWOOD W/ LATCH & WOOD CASING - PAINT OUT TO MATCH WALL.
23. SEE TYPICAL FRAMING @ STUDWALLS FOR DOORS SHEET A-4.0
24. 6" 20 GA. METAL STUDS @ 24" O.C. SPACING W/ C1" x 1" PURLINS + 3.1/2" F-G BATT INSUL. - COVER W/ 5/8" GYP. BD. (PAINTED) SEE DETAILS SHEET A-2.0
25. EXTEND 4" CONC. WALK UPTO DOOR #019 AS SHOWN.
26. INSTALL AL. STOREFRONT DOOR & FRAME THIS LOCATION - SEE SCHEDULE
27. INSTALL 20 GA. METAL STUDS @ 24" O.C. SPACING @ JOB LINK AREA - EXTEND TO DECK & INSTALL 5/8" GYP. BD. TYP. BOTH SIDES. (EXTEND GYP. BD. FULL HGT. ON BOTH SIDES OF WALL) W/ PURLINS. INSULATE WALL W/ 3.1/2" F-G BATTS.
28. APPROXIMATE BAILER LOCATION - VERIFY W/ OWNER PRIOR TO ELECTRICAL INSTALLATION - SEE ELEC.
29. INSTALL 42" x 36" HINGED ACCESS PANEL @ 10'-0" A.F.F 3/4" PLYWOOD W/ LATCH & WOOD CASING - PAINT OUT TO MATCH WALL - ADJ. HGT. TO AVOID BOTTOM CHORD OF BAR JOIST.
30. INSTALL 3/4" OSB DECKING OVER 800 CSJ JOISTS ABOVE MEN'S TLT. MECH. PLATFORM.

FINISH SCHEDULE



FLOOR:

01 CONCRETE - POLISHED, SEE SPECIFICATIONS.
02 12" x 12" x 1/8" VCT - SEE SPECIFICATIONS
03 CARPET TILES AS SELECTED - SEE SPECIFICATIONS

BASE:

10 4" RUBBER COVE
11 2x6 BASE + 2x6 CHAIR RAIL BUMPER STRIPS @ 42" A.F.F. - CONT. PAINTED - INSTALL TREATED 2xs ONTO BLOCK WALLS.
12 NONE

GENERAL NOTES:

1. EXTEND GYP. BD. ON INTERIOR WALLS FULL HGT - SEE SCHEDULE BELOW
2. PURLINS TO BE INSTALLED IN ALL STUD WALLS @ MIDPOINT, SEE SECTIONS.
3. COORDINATE ALL FINISHES LISTED WITH SPECIFICATIONS & ARCHITECT.

WALLS:

20 INTERIOR MASONRY WALLS, PAINTED PER SPECIFICATIONS.
21 5/8" GYP. BD. PRIME + TWO COATS LATEX SEMI-GLOSS AS PER SPECIFICATIONS.
22 FRP PANELS ON FRAME WALLS TO CEILING OVER 5/8" MOISTURE RESISTANT GYP. B D.

CEILING:

30 EXPOSED OPEN CEILINGS - PAINTED (DRY FOG WHITE)
31 5/8" GYP. BD. - PAINTED FINISH.
32 LAY-IN - 2x4 GRID W/TILES AS SELECTED.

CEILING HGT.:

40 15'-4" @ EXPOSED OPEN CEILING TO DECK SLOPES TO 13'-4" @ REAR WALL.
41 9'-0" @ GYP. BD. CEILINGS.
42 10'-0" +/- A.F.F.

CVR125 03/20/95 STONE SCALE = 1/8" = 1'-0"

DATE: 11/14/2008
COMM. NO.: 080806
DRAWN BY: STONE
CHECKED BY: WILLIAMS

NOTES:
1 REV PER OWNER COMMENTS DATED 1-14-09

© Copyright 2008
THESE DRAWINGS ARE PROTECTED UNDER FEDERAL COPYRIGHT LAWS. DO NOT REPRODUCE WITHOUT WRITTEN PERMISSION OF THE ARCHITECT

STATE OF SOUTH CAROLINA
DENNIS WILLIAMS
LINCOLNTON, NC
3788
REGISTERED ARCHITECT
SEAL

DENNIS WILLIAMS, A.I.A.
P.O. DRAWER 1159 704/732-4515
126 E. SYCAMORE LINCOLNTON, N.C. 28092

A NEW FACILITY FOR:
GOODWILL INDUSTRIES
WALTERBORO, S. C.

FLOOR PLAN
SHEET NO: A-1.0
080806FP1